


- Notes:
1. No more than two (2) conductors per phase shall be allowed.
 2. A galvanized wiring trough system shall be used on this type of installation.
 3. Line taps shall be made in the trough system by the electrical contractor.
 4. Weatherproof fittings required.
 5. Wire sized to total disconnect sizes.
 6. Neutral(s) may be reduced no more than two sizes on residential application. No reduction of the neutral(s) is allowed on commercial application.
 7. Meter pole must remain free of structures and private attachments other than meter loop assembly.

THREE PHASE APPLICATIONS ONLY
DESCRIPTION:

200amp, 7 terminal, 3-phase, 4-wire will require a lever by-pass meeting ANSI C12-7, UL 414, and NEMA 3R. Meter cans are available for purchase through Techline or any other electrical supplier provided it meets all Bluebonnet Electric Cooperative specifications.
Giddings(979-542-8657)
Brenham (979-277-7240)
Red Rock (512-332-2978)

*** WIRING INSTALLATIONS MUST MEET LOCAL GUIDELINES, IF APPLICABLE, SET FORTH BY CITY, COUNTY, OR OTHER GOVERNING ENTITY IN THE EVENT THESE REQUIREMENTS ARE MORE STRINGENT THAN BLUEBONNET SPECIFICATIONS. ***

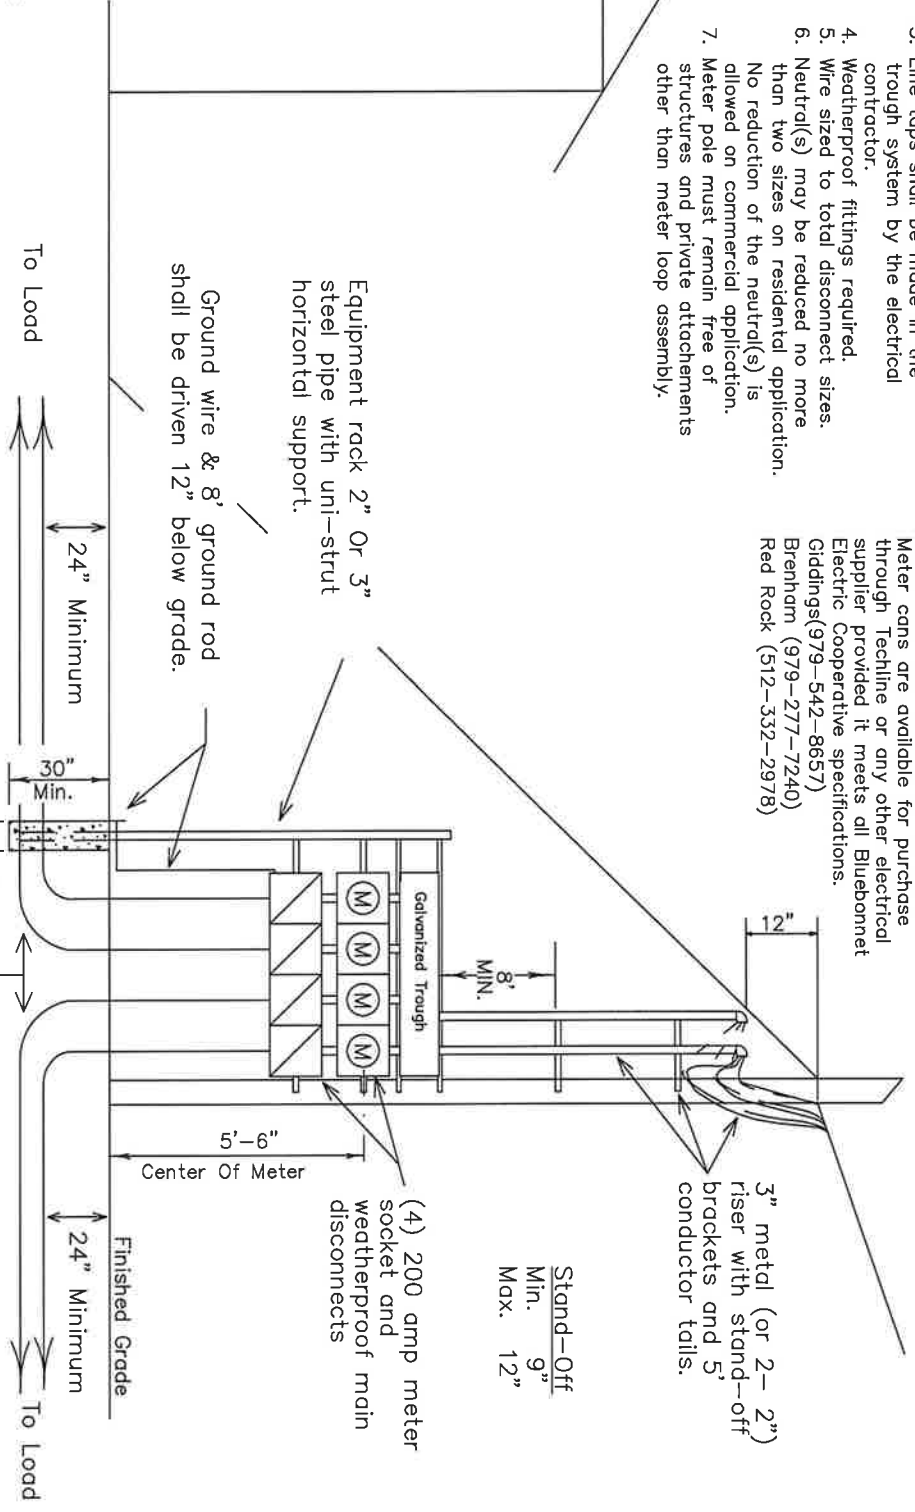

FOR THE MEMBER'S SAFETY, WIRING INSTALLATIONS SHALL CONFORM TO THE REQUIREMENTS OF THE NEC, TDLR AND NEESC.

Latest update can be found at www.bluebonnetelectric.coop/setup/meter.shtml

Bluebonnet Electric Cooperative, Inc.
P.O. Box 729
Bastrop, Texas 78602

1Ø OR 3Ø, 60-200 AMP GANG MOUNTED METERS ON BLUEBONNET METER POLE		Drawn By : BS	Checked By : SE	Approved By : EK
DATE	REVISIONS	Scale : NONE		
10-15-09	Meter can lever by-pass	Date:	11-20-09	MS-104
11-20-09	Wiring installations local guidelines			