WIRING INSTALLATIONS MUST MEET LOCAL GUIDELINES, IF APPLICABLE, SET FORTH BY CITY, COUNTY, OR OTHER GOVERNING ENTITY IN THE EVENT THESE REQUIREMENTS ARE MORE STRINGENT THAN BLUEBONNET SPECIFICATIONS.

THREE PHASE APPLICATIONS ONLY
DESCRIPTION:
200amp, 7 terminal, 3–phase, 4–wire will require a lever by–pass meeting ANSI C12.7, UL 414, and NEMA 3R. Meter cans are available for purchase through Techline or any other electrical supplier provided it meets all Bluebonnet Electric Cooperative specifications.
Giddings(979–542–8657)
Brenham (979–277–7240)
Red Rock (512–332–2978)

Notes:
1. Line taps shall be made in the galvanized trough by the electrical contractor.
2. More than (6) main disconnects require a properly sized main disconnect ahead of the galvanized trough.
3. Weatherproof fittings required.
4. Wire sized to total disconnect sizes.
5. Neutral(s) may be reduced no more than two sizes on residental application. No reduction of the neutral(s) is allowed on commercial application.
6. For all URD jobs, electricians should call in for locate before digging to Bluebonnet equipment.
7. Bluebonnet will complete wiring into transformer. Have sufficent amoint of wire for termination.
8. Meter loop must remain unenclosed on exterior of structure.
9. Meter loop can not be mounted on the side of a mobile home.

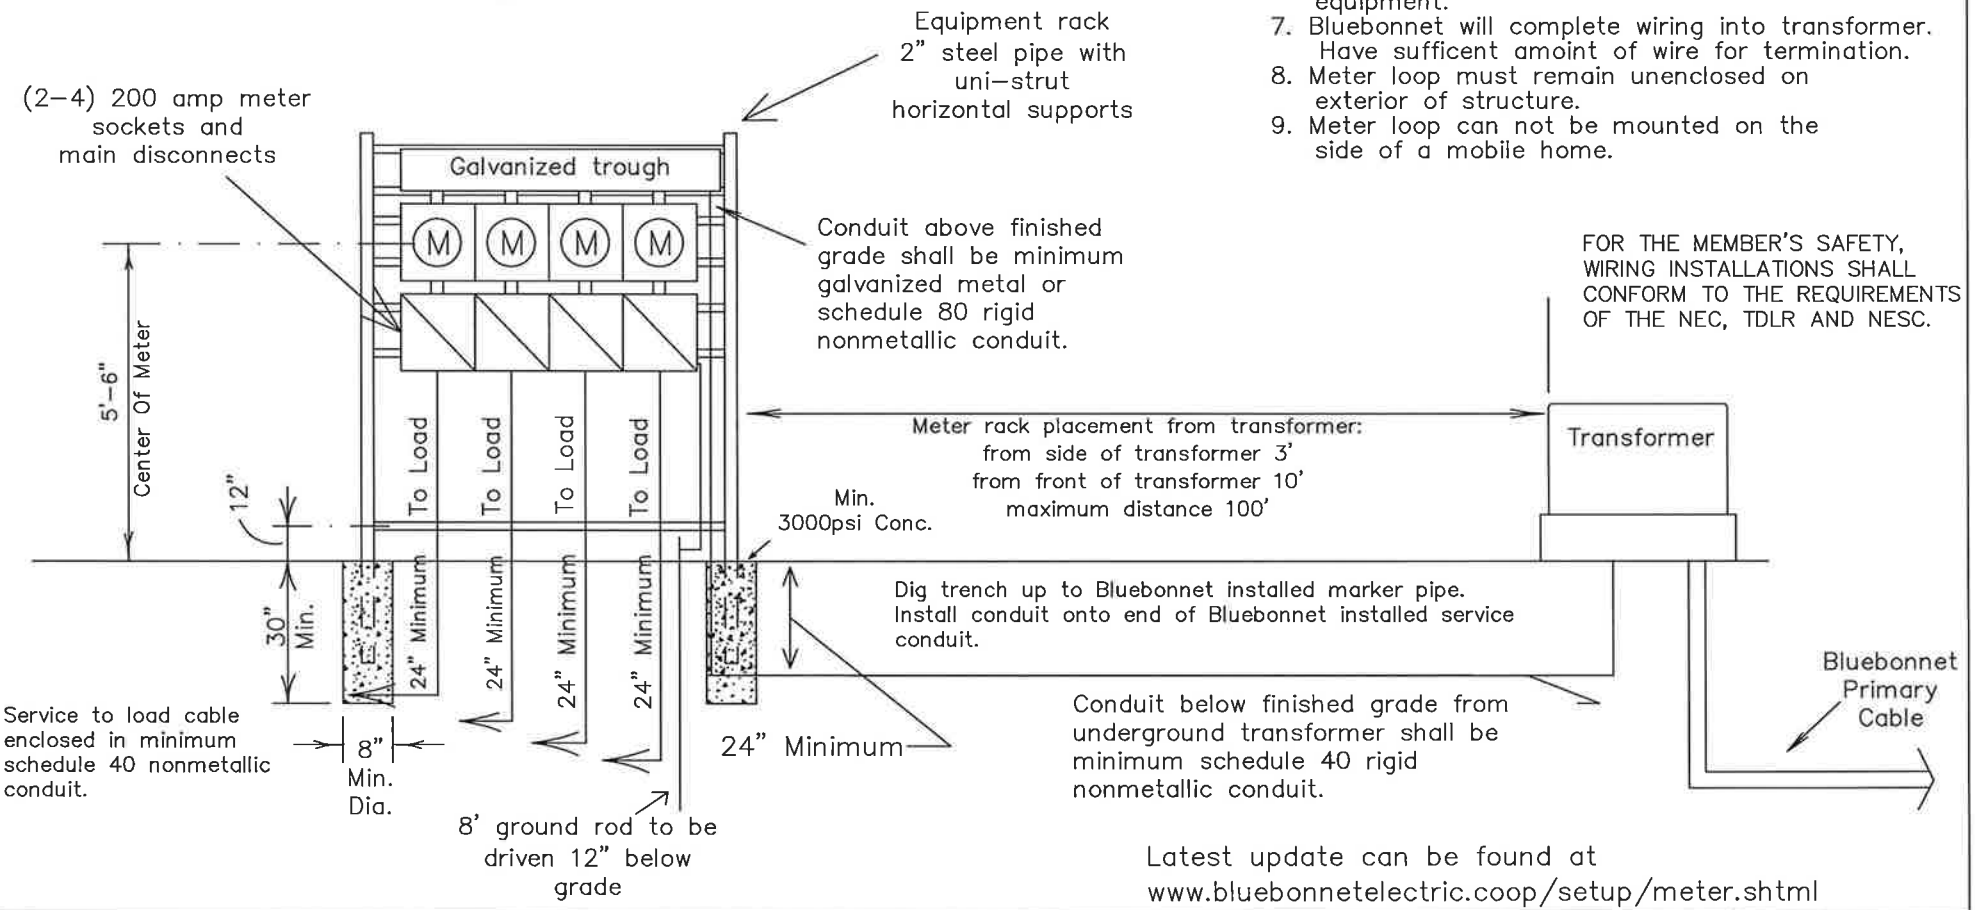

Latest update can be found at
www.bluebonnetelectric.coop/setup/meter.shtml

Bluebonnet Electric Cooperative, Inc. P.O. Box 729 Bastrop, Texas 78602	1Ø OR 3Ø, 60–200 AMP URD GANG MOUNTED METERS ON RACK OR BUILDING	Drawn By : BS	Checked By : SE	Approved By : EK
	DATE / REVISIONS 10–15–09 Meter can lever by–pass 11–20–09 Wiring installations local guidelines	Scale : NONE	Date : 11–20–09	MS–205