


**Notes:**

- Line taps shall be made in the galvanized wiring trough by the electrical contractor.
- Weatherproof fittings Required.
- (2) disconnects could be substituted with (1) disconnect. All disconnects shall have over current protection installed.
- No more than (2) risers or (2) conductors per phase shall be allowed.
- Wire shall be sized to total name plate disconnect sizes.
- Neutral(s) may be reduced no more than two sizes on residential application. No reduction of the neutral(s) is allowed on commercial application.
- The electrical contractor will notify Bluebonnet 72 hours in advance to schedule Bluebonnet personnel to deliver the CT's before the service wire is pulled. The electrician shall install them on the rack with the correct polarity before the conductor is brought thru the 30"x42" (minimum size) CT enclosure. Call 800-842-7708 to schedule a connect.

- More than (6) main disconnects require a properly sized main disconnect ahead of the galvanized trough.
- Bluebonnet pole must remain free of structures and private attachments other than meter loop riser assembly.
- Meter assembly must remain unenclosed on exterior of structure.
- Type K-4, Bolt-in type meter can: Description: 400 amp, 4 terminals, 3-wire, residential/commercial socket single phase self-contained, large cover plate. These meter cans are available for purchase through Techline (512-332-2978) or any other electrical supplier provided it meets all Bluebonnet Electric Cooperative specifications.
- Maintain 3"-6" distance from the disconnect and the meter can. Member shall use a metal nipple. A straight or offset nipple is acceptable.

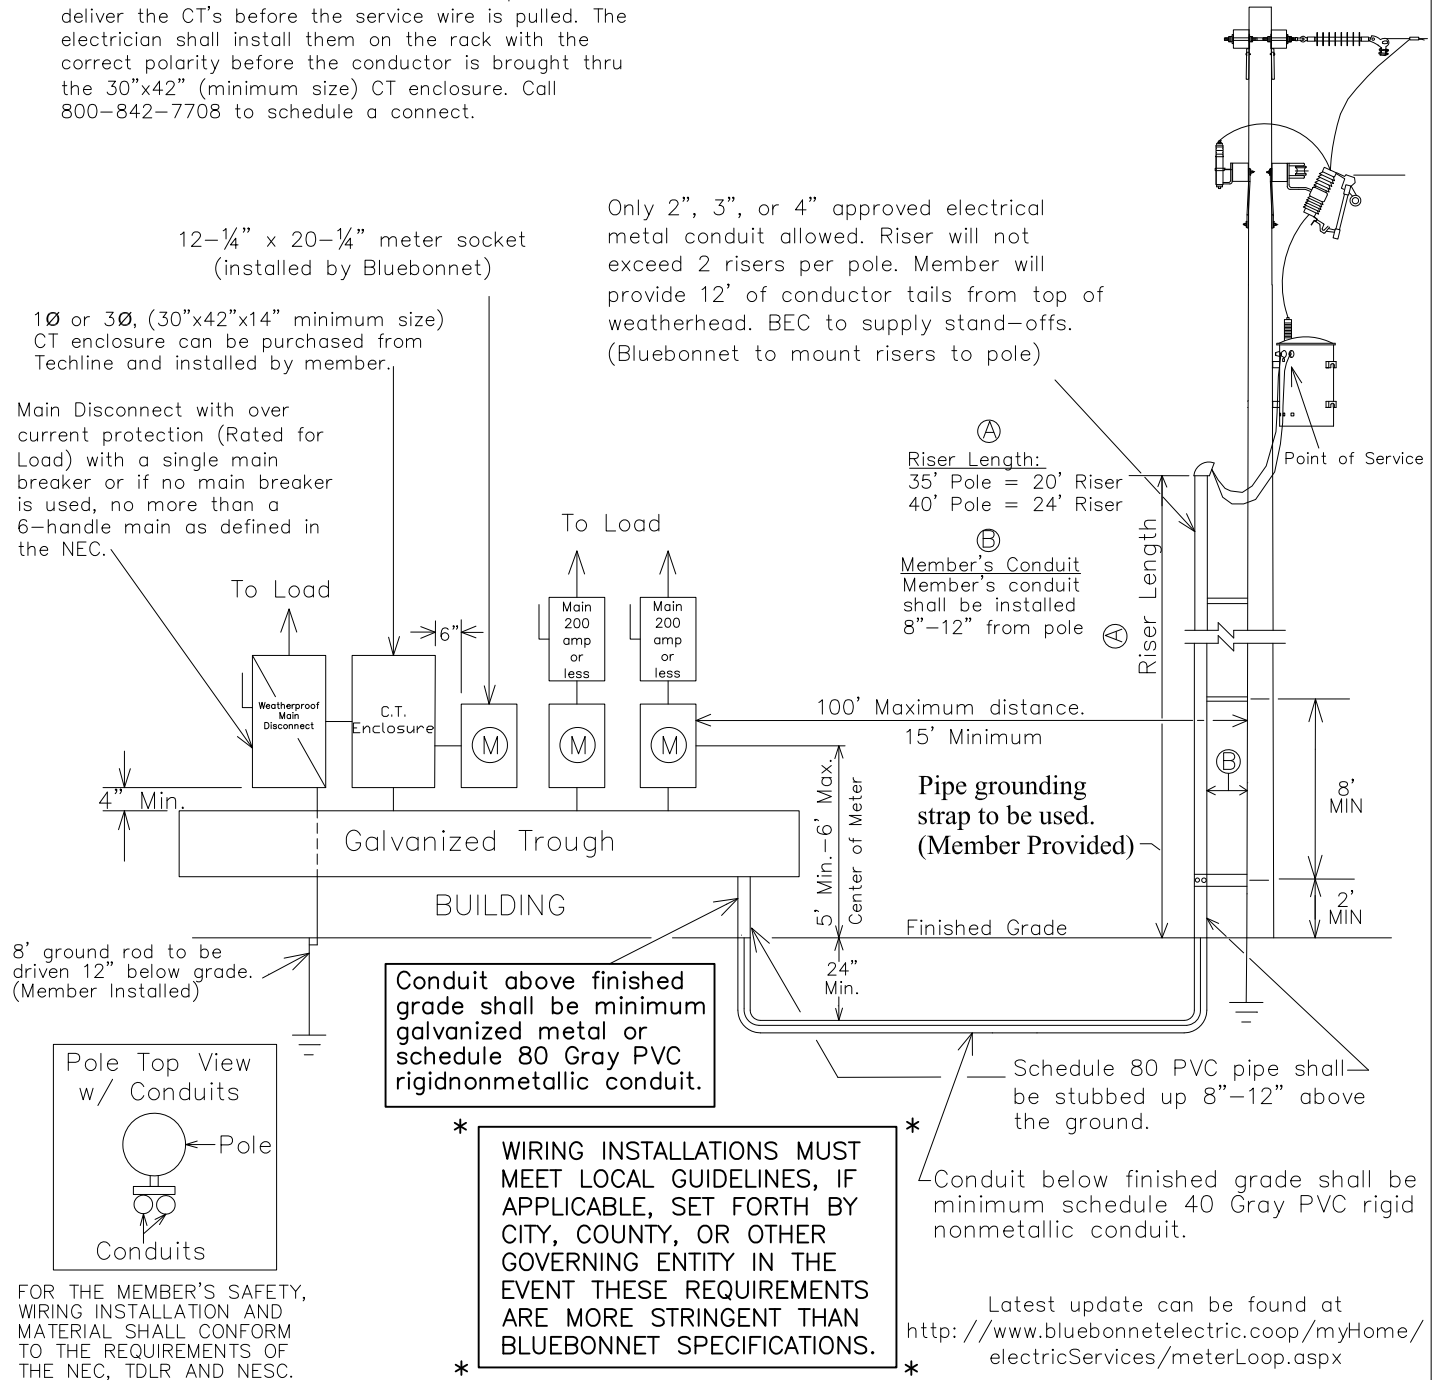

1Ø 400-800 TOTAL AMPS WITH MULTIPLE METERING POINTS ON BUILDING. (RISER TYPE)



DATE	REVISIONS
01-29-2017	Changed the dimensions of the CT Enclosure.
11/28/2017	Bold lettering of Pipe grounding Strap

Drawn By : RG	Checked By : MS COMMITTEE	Approved By : TE
Scale : NONE	Date : 11/28/2017	MS-114A1